

NOTES:

1. CONTRACTOR SHALL BE RESPONSIBLE FOR PROTECTION OF EXISTING SEWER AND OTHER UTILITIES, PROPER BACKFILLING, COMPACTING, AND SURFACE RESTORATION.
2. CONTRACTOR MUST ACCURATELY SIZE AND PROCURE CONNECTION FITTINGS BASED ON THE EXISTING DISTRICT SEWER (MATERIAL AND DIAMETER) AND THE LATERAL SEWER (MATERIAL AND DIAMETER) TO BE CONNECTED.
3. CONTRACTOR SHALL MANUALLY BACKFILL AND COMPACT AROUND THE CONNECTION UNTIL A MINIMUM OF 12" OF COVER IS PLACED OVER THE PIPE AND CONNECTION.
4. WHEN ORDERING THE FATBOY INSERTA-TEE, PROVIDE THE EXISTING DISTRICT SEWER PIPE'S DIAMETER, WALL THICKNESS AND STIFFNESS AND THE LATERAL MATERIAL, DIAMETER, AND STIFFNESS (SDR) TO BE INSTALLED. WHERE CIPP LINERS ARE PRESENT, PROVIDE THE LINER THICKNESS FOR PROPER SIZING OF THE RUBBER SLEEVE.

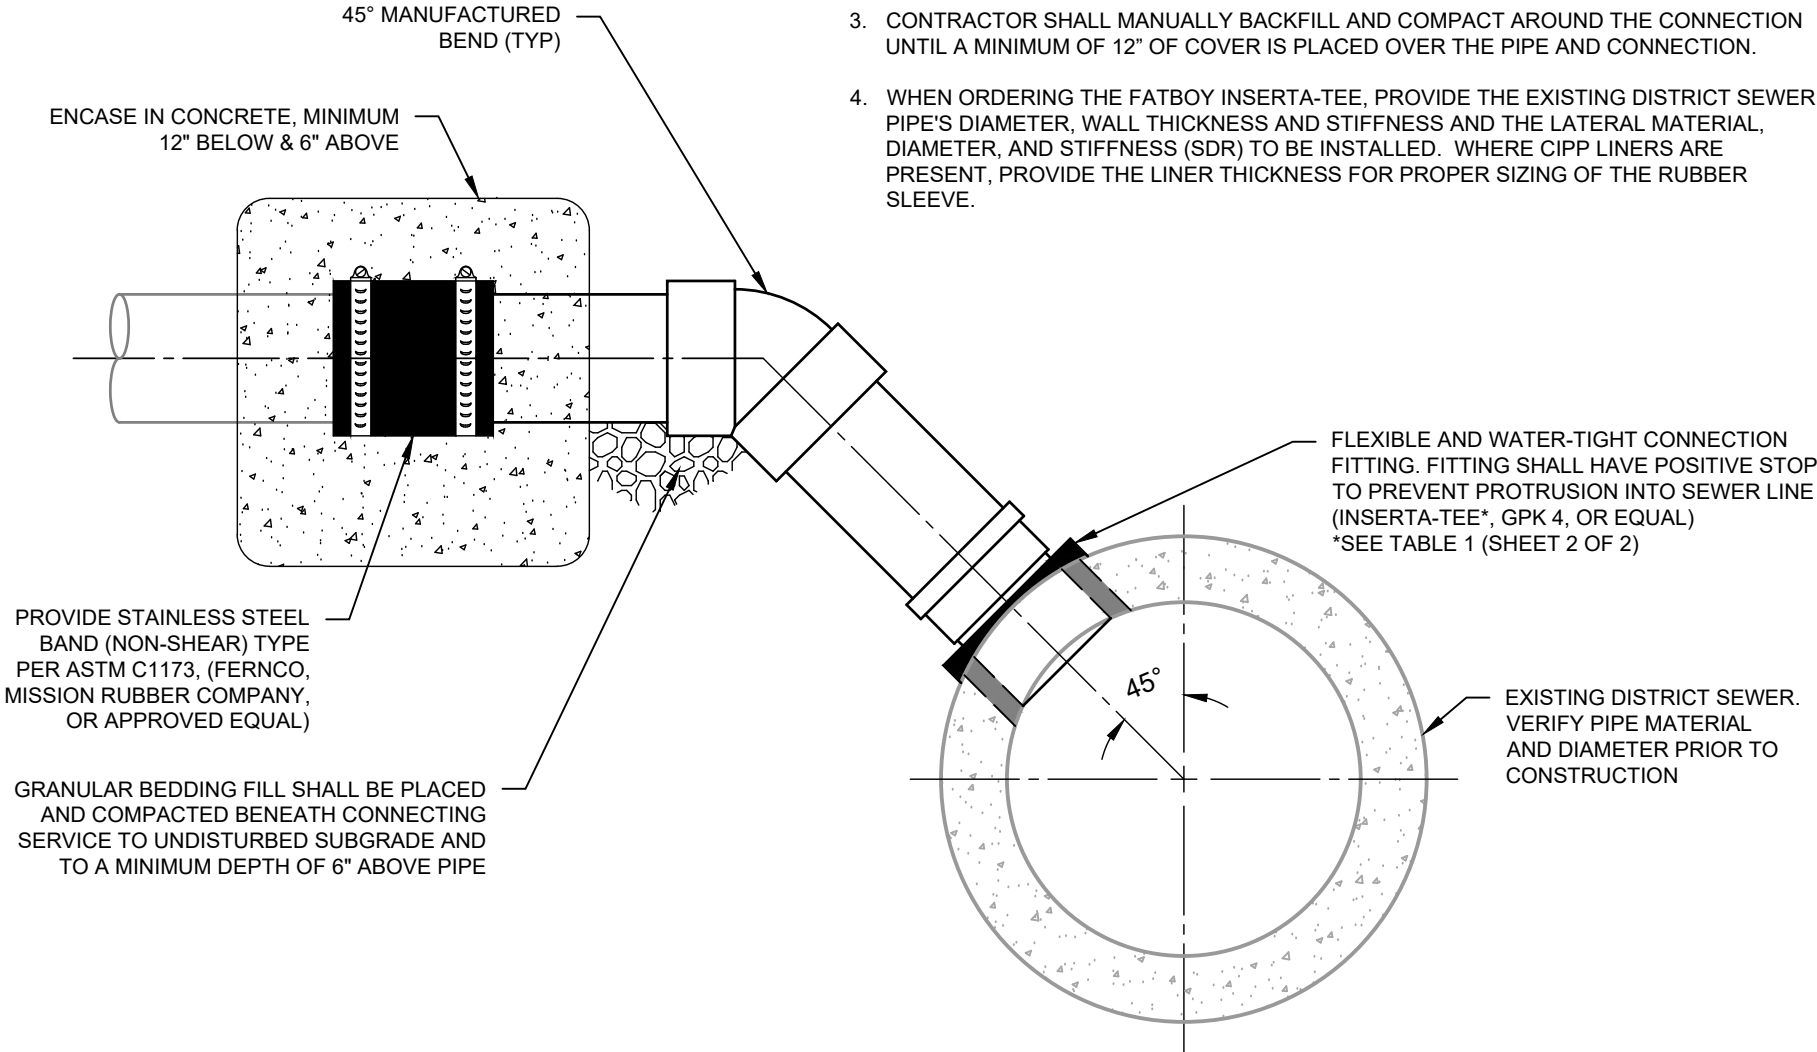


TABLE 1

Rehabilitated District Concrete Pipe	CIPP Liner Thickness		INSERTA-TEE* ORDERING INFORMATION Lateral Nominal Diameter (inch)
Nominal Pipe Diameter (in)	Minimum Liner Thickness (mm)	Maximum Liner Thickness (mm)	4
12	3.5	5	4P26FB12CIP
15	4.5	6	4P26FB15CIP
18	5	7	4P26FB18CIP
21	5.5	8	4P26FB21CIP
24	7	9	4P26FB24CIP
27	8	10	4P26FB27CIP
30	8	12	4P26FB30CIP
36	8	12	4P26FB36CIP
42	8	12	4P26FB42CIP

1. WHEN ORDERING INSERTA-TEE*, CONTRACTOR SHALL PROVIDE THE NOMINAL DISTRICT PIPE DIAMETER, LATERAL DIAMETER AND MATERIAL TO BE INSTALLED, AND EXISTING CIPP LINER THICKNESS TO VERIFY PROPER SIZING OF THE RUBBER SLEEVE. INSERTA-TEE* WITH RUBBER SLEEVE THICKNESS SIZED WITHOUT VERIFICATION SHALL NOT BE ACCEPTED BY THE DISTRICT.

